



ULTIMATE

Fault tolerant power
without compromise

MODULYS RM GP

Rack-mounted modular UPS system

Green Power 2.0 range

up to 4 x 25 kVA/kW



OBJECTIVES

The aim of these specifications is to provide the information required to prepare the system and installation site.

The specifications are intended for:

- installation engineers,
- design engineers,
- engineering consultants.

Please contact us for further information, or if you would like to receive a full documentation package for detailed product know-how, including schematics, integration instructions, technical data sheets, user's manual, etc.



1. ARCHITECTURE

1.1 RANGE AND FLEXIBILITY

MODULYS RM GP is a 3-phase modular UPS system designed for 19" rack integration. The product is easy to integrate and install, as well as being very simple to operate and maintain. It provides maximum power availability and protection in a compact design that leaves free space for other rack mounted devices.

MODULYS RM GP:

- provides easy and fully-assured rack integration to meet all requirements across multiple applications, even for existing installations;
- simplifies and optimises every step of the integration process - from sizing to installation, including the logistics, making project management easy, risk-free and economic;
- provides reliable power whilst ensuring optimum load protection even during power upgrades or maintenance procedures.

Pre-cabled rack with maintenance bypass

M4-R-075-82B0 15 U rack, 4 slots
M4-R-050-82B0 9U rack, 2 slots

Plug-in boards

1C-CP-OP-ADC+SL Programmable IN/OUT dry contact + serial link
1C-CP-OP-MODTCP MODBUS TCP interface
NET-VISION7CARD NET VISION card, WEB/SNMP interface IPV4/IPV6

Other options

NET-VISION-EMD Environment temp. and humidity sensor + 4 dry contacts
1C-OP-P-TEMP External temperature sensor

Blank panel

M4-OP-SSC Cover for empty slot

Power module - 25 kW


M4-RI-25

4U battery rack

M4-BR-009L With 42 x 9Ah batteries, fuse and switch
M4-BR-009L-B Empty, for 42 x 9Ah batteries, including interconnections, fuses and switch



Mounting accessories

M4-RI-OP-RAIL Adjustable rails for rack mounting support

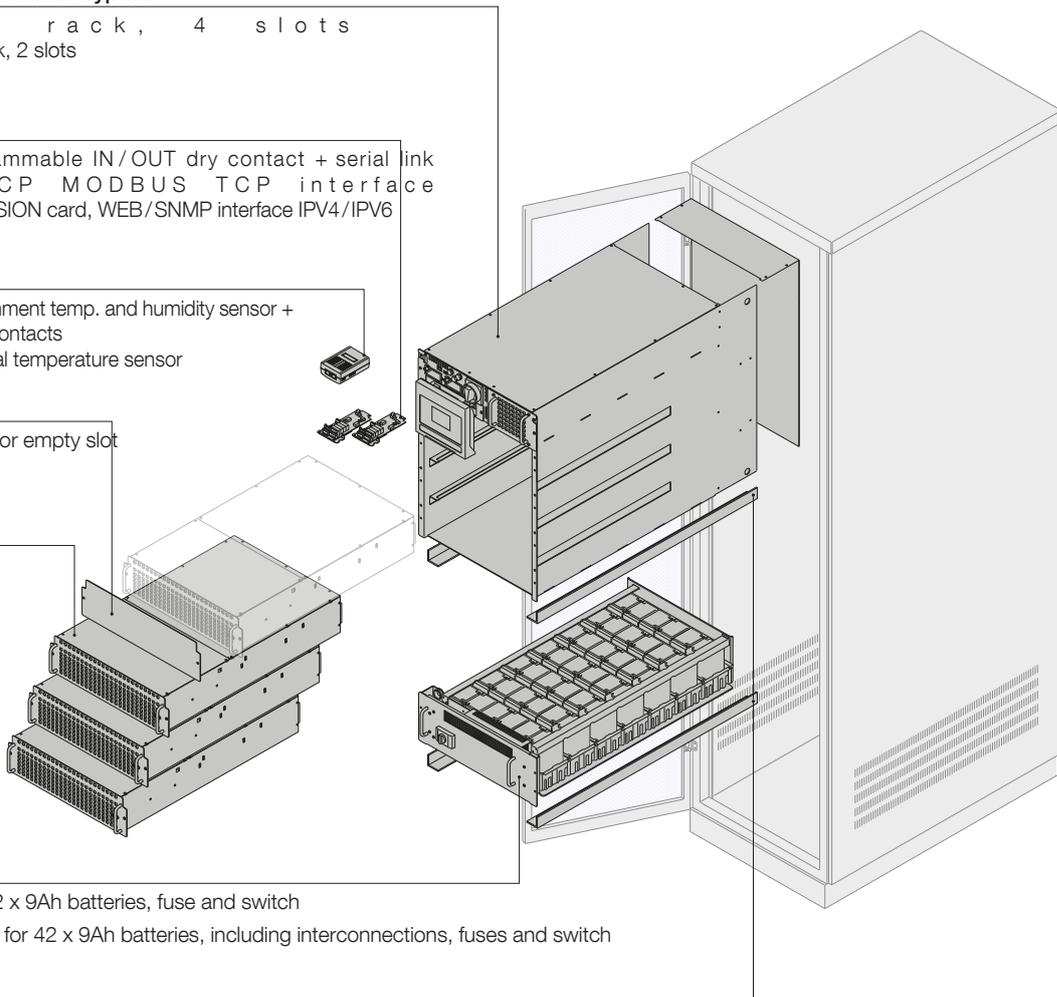

GREEN 155 A

MODULYS RM GP
up to 4 x 25 kVA/kW

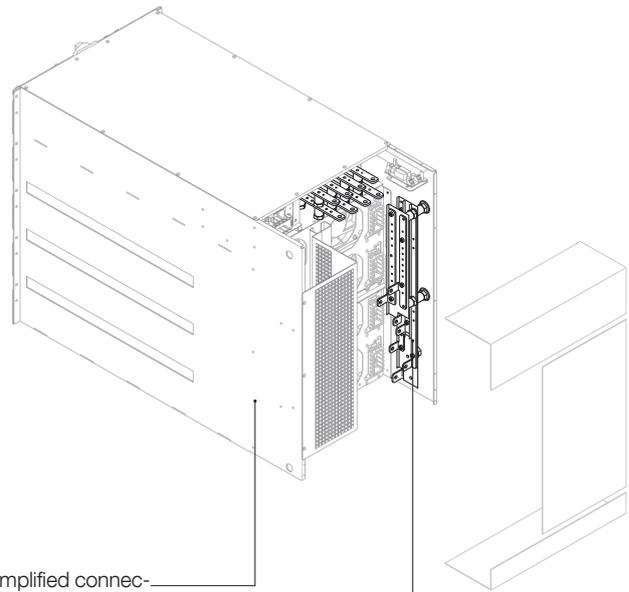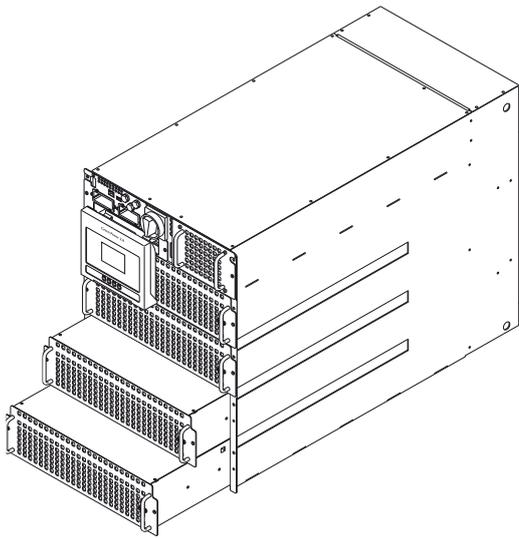

Pre-cabled system for simplified connections


Flexible cabling management for top, bottom and mixed top / bottom entry cable

No centralised control for parallel and load sharing management

Totally independent and self-sufficient hot-swap power modules

Electronics-free (failure-free) sub-rack enclosure

Battery rack
Independent battery strings with individual switch and protection



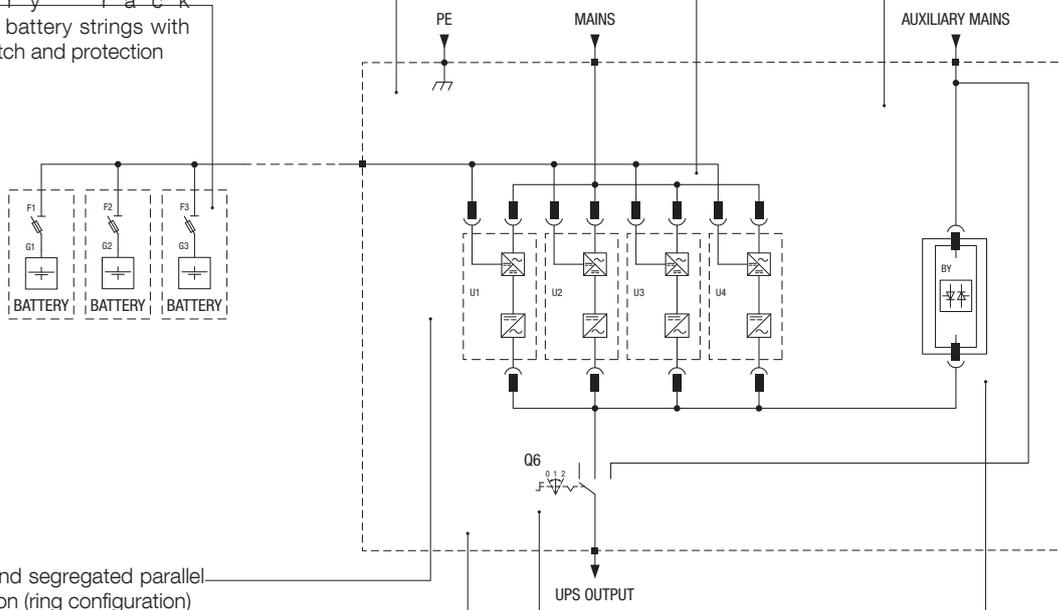


Redundant and segregated parallel bus connection (ring configuration)

No single point of failure

Embedded manual bypass

Totally segregated, fully sized and centralised hot-swap auxiliary mains bypass

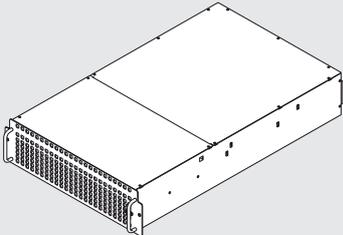Configurations and rated power (kW)					
					
		M4-RI-25			
		Number of power modules			
		1	2	3	4
	N configuration	25	50	75	-
	N+1 redundancy	-	25	50	75
M4-R-075-82B0					
	N configuration	25	50	-	-
	1+1 redundancy	-	25	-	-
M4-R-050-82B0					

1.2 FLEXIBLE BACK-UP TIME

Different extended back-up times are possible by using: (1) 4U rack-mounted battery modules; (2) a modular battery cabinet; (3) a high capacity battery cabinet.

Each battery pack comprises an acid-proof container designed to prevent damage in case of acid leakage.

Each Power Module has a powerful embedded battery charger able to provide up to 8 A (without power derating).


A special Power Module with extra battery charger inside is available when very long back-up times are required.




MODULYS RM GP is compatible with different battery technologies.


Battery block dynamics ⁽¹⁾		
Sealed lead-acid	Min	108 + 108
	Max	144 + 144
Open vented (flooded lead-acid)	Min	108 + 108
	Max	144 + 144
Nickel Cadmium	Min	180 + 180
	Max	228 + 228

2 strings/3 cables configuration (+ N -).

1.2.1 4U RACK-MOUNTED BATTERY MODULES

Dimensions and weight		
	Height (mm)	175
	Depth (mm)	920
	Width (mm)	442 (482)
	Weight - empty (kg)	23
M4-BR-009L	Weight - with batteries (kg)	136

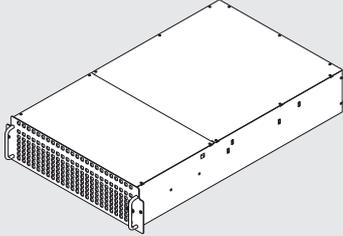
4U	rack-mounted	battery	modules		
Back up times in minutes at rated load					
					
		M4-RI-25			
		Number of power modules			
	Without redundancy	1	2	3	
	N+1 redundancy	2	3	4	
M4-R-075-82B0					
	Without redundancy	1	2	-	
	1+1 redundancy	2	-	-	
M4-R-050-82B0					

		Load power (kW)	5	10	15	18	20	25	30	36	40	50	54	60	75	
	Number of battery racks	1	9	25	11	6	4	3	-	-	-	-	-	-	-	
		2	18	62	26	17	13	11	8	6	4	3	-	-	-	-
		3	27	100	44	26	22	19	15	11	8	7	5	4	3	-
		4	36	138	64	40	31	26	20	17	13	11	8	7	6	4
		5	45	176	84	51	41	37	26	21	17	15	11	9	8	6
	M4-BR-009L	> 5	consult us													

1.2.2 MODULAR HOT-SWAP BATTERY CABINET

The modular battery system is based on vertical and horizontal modularity thanks to independent battery strings connected in parallel, each string comprising hot-swap long life battery packs.

Each battery string has its own independent protection and its own independent switch for fast and safe maintenance.

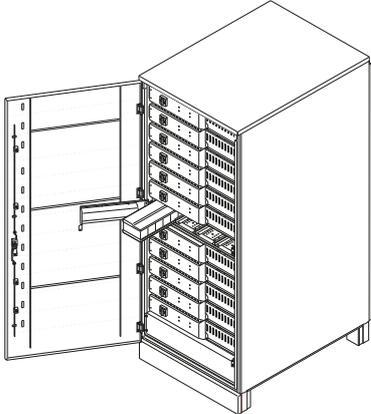Modular hot-swap battery cabinet		
	Number of strings	Item code
	0 (empty cabinet)	M4-BH-00S-009L
	1	M4-BH-01S-009L
	2	M4-BH-02S-009L
	3	M4-BH-03S-009L
	4	M4-BH-04S-009L
	5	M4-BH-05S-009L
	6	M4-BH-06S-009L
	7	M4-BH-07S-009L
	8	M4-BH-08S-009L
	9	M4-BH-09S-009L
	10	M4-BH-10S-009L
	11	M4-BH-11S-009L
12	M4-BH-12S-009L	


Dimensions and weight																																					
	Number of battery cabinets																																				
	1										2										3																
	Number of strings																																				
	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36
Height (mm)	1990																																				
Depth (mm)	950																																				
Width (mm)	810										1620										2430																
Weight (kg)	260	384	508	632	756	880	1004	1128	1252	1376	1500	1624	1748	2132	2256	2380	2504	2628	2752	2876	3000	3124	3248	3372	3496	3880	4004	4128	4252	4376	4500	4624	4748	4872	4996	5120	5244

Modular hot-swap battery cabinet Back up times in minutes @ 75 % of rated load

					Number of power modules								Number of power modules		
Without redundancy					1	2	3	Without redundancy					1	2	
N+1 redundancy					2	3	4	1+1 redundancy					2	-	
Number of battery cabinets	1	Number of strings	1	Cumulative Ah	9	5	-	-	1	Number of strings	1	Cumulative Ah	9	5	-
			2		18	15	5	-			2		18	15	5
			3		27	23	9	5			3		27	23	9
			4		36	34	15	8			4		36	34	15
			5		45	44	19	11			5		45	44	19
			6		54	57	23	15			6		54	57	23
			7		63	68	28	18			7		63	68	28
			8		72	80	34	20			8		72	80	34
			9		81	92	40	23			9		81	92	40
			10		90	103	44	26			10		90	103	44
			11		99	116	51	30			11		99	116	51
			12		108	129	57	34			12		108	129	57
	2	Number of strings	13	117	141	63	38	13	117	141	63				
			14	126	151	68	41	14	126	151	68				
			15	135	163	73	44	15	135	163	73				
			16	144	177	80	48	16	144	177	80				
			17	153	190	86	53	17	153	190	86				
			18	162	206	92	57	18	162	206	92				
			19	171	221	98	61	19	171	221	98				
			20	180	235	103	65	20	180	235	103				
			21	189	249	109	68	21	189	249	109				
			22	198	261	116	71	22	198	261	116				
			23	207	272	123	75	23	207	272	123				
			3	Number of strings	24	216	282	129	80	24	216	282	129		
	25	225			294	135	84	25	225	294	135				
	26	234			310	141	88	26	234	310	141				
	27	243			326	146	92	27	243	326	146				
	28	252			341	151	96	28	252	341	151				
	29	261			354	156	99	29	261	354	156				
	30	270			367	163	103	30	270	367	163				
	31	279			383	170	107	31	279	383	170				
	32	288			402	177	111	32	288	402	177				
	33	297			419	183	116	33	297	419	183				
	34	306			436	190	120	34	306	436	190				
	35	315			451	197	125	35	315	451	197				
	36	324	466	206	129	36	324	466	206						

For very long BUT, it is recommended to use the power module with 16 A charging current (refer to page 14).

1.2.3 MODULAR BATTERY CABINET - HIGH CAPACITY

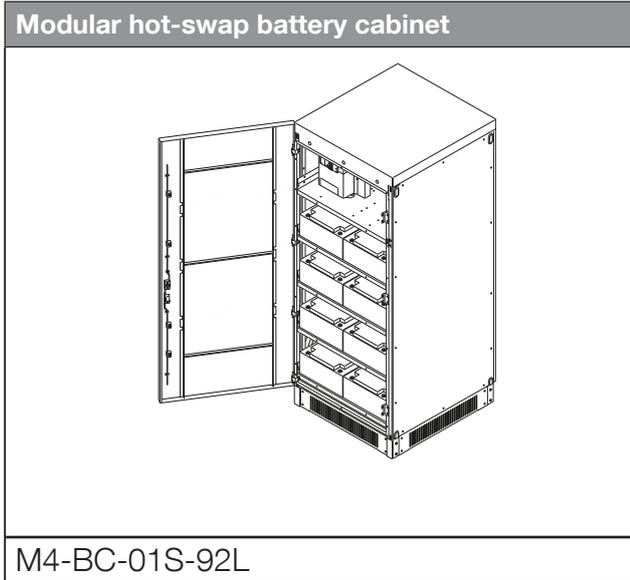

Dimensions and weight

	Number of strings	
	0	1
Height (mm)	1990	
Depth (mm)	890	
Width (mm)	810	
Weight (kg)	220	1792

MODULYS RM GP
up to 4 x 25 kVA/kW

Modular battery cabinet
Back up times in minutes @ 75 % of rated load

					Number of power modules			
					1	2	3	
Without redundancy								
N+1 redundancy					2	3	4	
Number of battery cabinets	1	Number of battery racks	Cumulative Ah	1	92	119	56	33
				2	184	279	119	75
				3	276	447	201	119
				4	368	654	279	170
				5	460	-	378	226
				6	552	-	-	279



Modular battery cabinet
Back up times in minutes @ 75 % of rated load

					Number of power modules		
					1	2	
Without redundancy							
1+1 redundancy					2	-	
Number of battery cabinets	1	Number of battery racks	Cumulative Ah	1	92	119	56
				2	184	279	119
				3	276	447	201
				4	368	654	279
				5	460	-	378

For very long BUT, it is recommended to use the power module with 16 A charging current (refer to page 14).

2. SPECIFICATIONS

2.1 INSTALLATION PARAMETERS

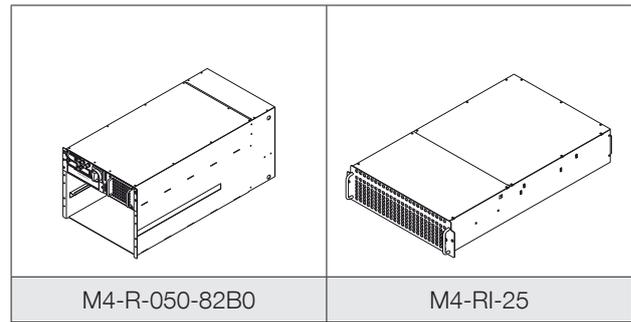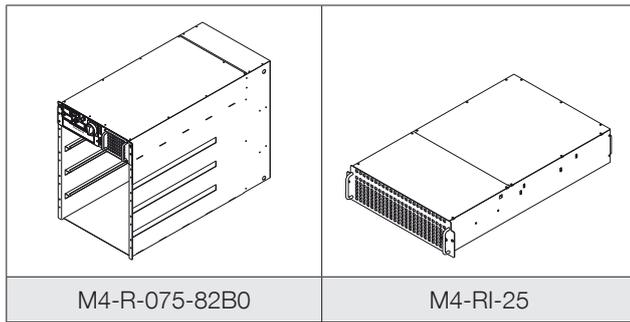

Configurations and rated power (kW)				
	Number of power modules			
	1	2	3	4
N configuration	25	50	75	-
N+1 redundancy	-	25	50	75

Configurations and rated power (kW)		
	Number of power modules	
	1	2
N configuration	25	50
1+1 redundancy	-	25


Rated current and max current			
	Number of power modules		
	1	2	3
Without redundancy	1	2	3
N+1 redundancy	2	3	4
Rated rectifier input current (A) (EN 62040-3)	37.7	75	113
Max rectifier input current (A) (EN 62040-3)	45.0	90	135
Rated inverter output current (A)	36.2	72	109
Maximum bypass input current (A) (EN 62040-3)	120		
Max battery current (A)	80	160	240

Rated current and max current		
	Number of power modules	
	1	2
Without redundancy	1	2
1+1 redundancy	2	-
Rated rectifier input current (A) (EN 62040-3)	37.7	75
Max rectifier input current (A) (EN 62040-3)	45.0	90
Rated inverter output current (A)	36.2	72
Maximum bypass input current (A) (EN 62040-3)	120	
Max battery current (A)	80	160

Cooling				
		Number of power modules		
		1	2	3
Without redundancy		1	2	3
N+1 redundancy		2	3	4
Maximum air flow	m ³ /h	400	800	1200
Max dissipation in nominal conditions ⁽¹⁾	W	1140	2280	3420
	kcal/h	980	1961	2941
	BTU/h	3891	7782	11672
Max dissipation in worst conditions ⁽²⁾	W	1350	2650	3950
	kcal/h	1161	2279	3397
	BTU/h	4608	9044	13481

Cooling			
		Number of power modules	
		1	2
Without redundancy		1	2
1+1 redundancy		2	-
Maximum air flow	m ³ /h	400	800
Max dissipation in nominal conditions ⁽¹⁾	W	1140	2280
	kcal/h	980	1961
	BTU/h	3891	7782
Max dissipation in worst conditions ⁽²⁾	W	1350	2650
	kcal/h	1161	2279
	BTU/h	4608	9044

- (1) Nominal input voltage and rated output active power (PF1).
 (2) Low input voltage, battery recharge and rated output active power (PF1).

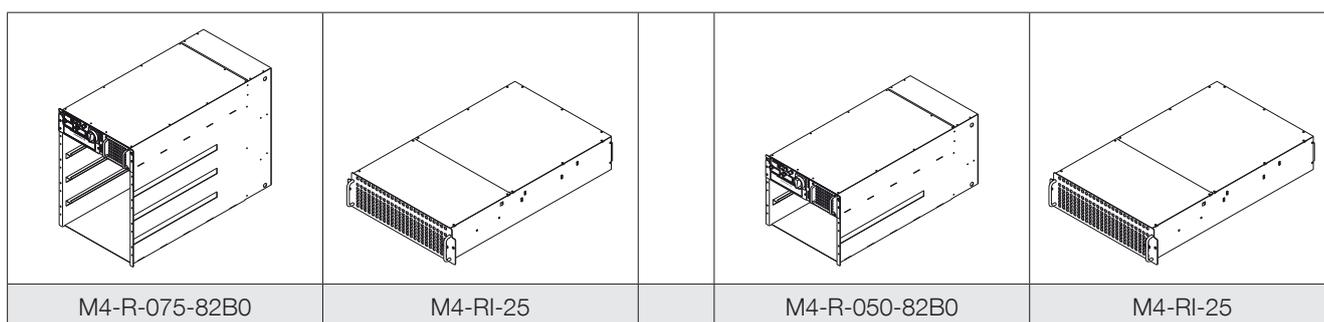

Acoustic noise			
	Number of power modules		
Without redundancy	1	2	3
N+1 redundancy	2	3	4
Acoustic noise at 1 m (dBA) ⁽¹⁾	51	53	54

Acoustic noise		
	Number of power modules	
Without redundancy	1	2
1+1 redundancy	2	-
Acoustic noise at 1 m (dBA) ⁽¹⁾	51	53

(1) 75 % of nominal load.

Dimensions and weight				
	Number of power modules			
	1	2	3	4
Height (mm)	664			
Depth (mm)	920			
Width (mm)	442 (482)			
Weight - sub-rack (kg)	49			
Weight (kg)	82	115	148	181


Dimensions and weight		
	Number of power modules	
	1	2
Height (mm)	397	
Depth (mm)	920	
Width (mm)	442 (482)	
Weight - sub-rack (kg)	43	
Weight (kg)	76	109

Environment	
Storage temperature	-5 to +50 °C
Operating temperature	0 to 40 °C ⁽¹⁾⁽²⁾
Maximum relative humidity	95 % condensation-free
Degree of protection	IP20


Environment	
Storage temperature	-5 to +50 °C
Operating temperature	0 to 40 °C ⁽¹⁾⁽²⁾
Maximum relative humidity	95 % condensation-free
Degree of protection	IP20

(1) A c c o r d i n g t o E N 6 2 0 4 0 - 3 .
(2) For optimum battery lifetime the ideal temperature range is 15 °C - 25 °C

Cabling system and max cable section

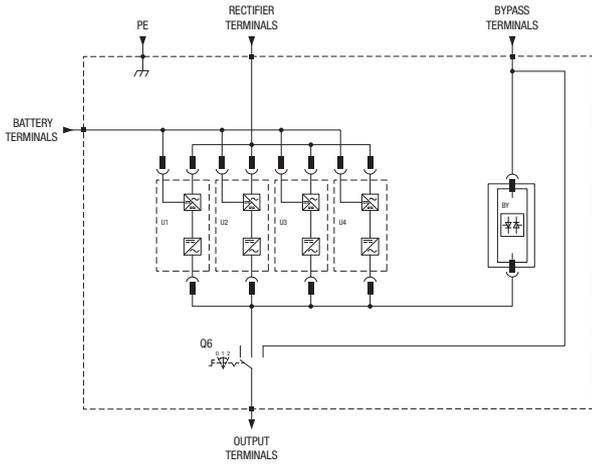

Cabling system and max cable section

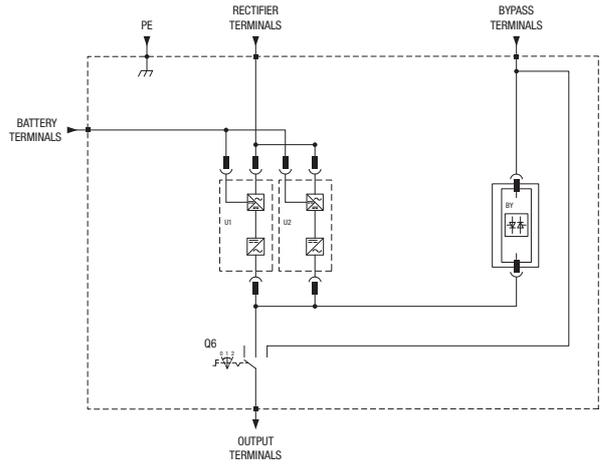

		Number of power modules						Number of power modules	
		1	2	3	4			1	2
Rectifier terminals (mm ²)	Flexible	50					Rectifier terminals (mm ²)	Flexible	35
	Rigid	50						Rigid	35
Bypass terminals (mm ²)	Flexible	50					Bypass terminals (mm ²)	Flexible	35
	Rigid	50						Rigid	35
Battery terminals (mm ²)	Flexible	70					Battery terminals (mm ²)	Flexible	35
	Rigid	70						Rigid	35
Output terminals (mm ²)	Flexible	50					Output terminals (mm ²)	Flexible	35
	Rigid	50						Rigid	35

2.2 ELECTRICAL CHARACTERISTICS

2.2.1 ELECTRICAL CHARACTERISTICS INDEPENDENT OF THE NUMBER OF MODULES

Electrical characteristics - Input	
Rated mains supply voltage (V)	400 V 3-phase+N
Voltage tolerance at full load	340 V to 480 V (+20/-15%)
Voltage tolerance at derated load	up to 240 V @ 50 % of nominal load (linear decrease)
Rated frequency (Hz)	50/60 ±10%
Power factor	> 0.99 ⁽¹⁾
Total harmonic input current distortion (THDi)	≤ 3 % (@: Pn, Resistive load, Mains THDv ≤ 1 %)
Max inrush current at start-up	Power walk-in/Soft-start (selectable parameters)

(1) Pout ≥ 50 % Sn.


Electrical characteristics - Bypass	
Bypass rated voltage (V)	Nominal output voltage ±15 % (±20% if GENSET is used)
Bypass rated frequency (Hz)	50/60
Bypass frequency tolerance (Hz)	±2 % selectable (±8% if GENSET is used)
Bypass frequency variation speed	50/60 ±10%

Electrical characteristics - Inverter	
Rated output voltage (V)	(3ph + N) 380/400/415 selectable
Output voltage tolerance (Hz)	±1
Rated output frequency (Hz)	50/60 (selectable)
Output frequency tolerance	±0.05 % (on battery mode)
Load crest factor	≥ 2.7:1
Total output voltage distortion (THDv)	≤ 1 % (Ph/Ph); ≤ 2 % (Ph/N) (@: Pn, Resistive load)

Electrical characteristics - Stored energy operating mode	
Number of battery blocks (VRLA)	From 18+18 to 24+24

Electrical characteristics - Efficiency	
Efficiency (on-line mode)	up to 96.5 %
Efficiency (eco-mode)	up to 99.3 %

2.2.2 ELECTRICAL CHARACTERISTICS DEPENDENT OF THE NUMBER OF MODULES

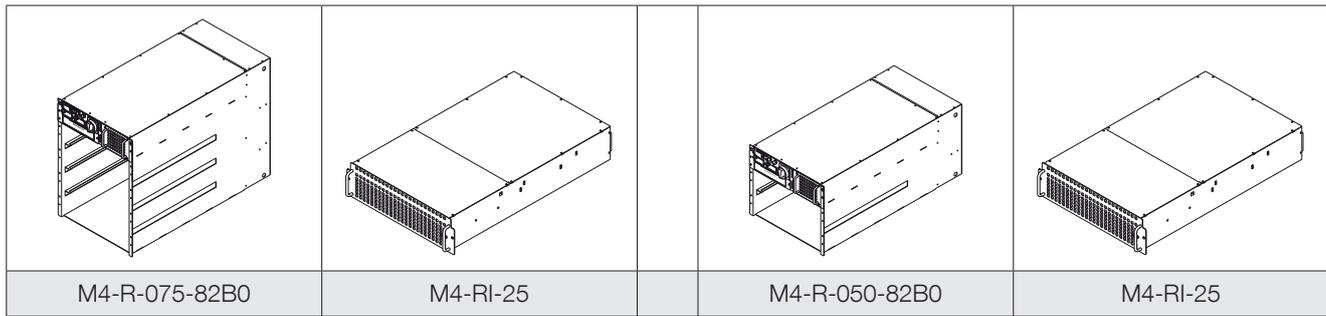

Electrical characteristics - Inverter overload

		Number of power modules					Number of power modules	
		1	2	3-4			1	2
Inverter overload (kW)(1)	10 min	31.2	62.4	94	Inverter overload (kW)(1)	10 min	31.2	62.4
	5 min	33.3	66.5	100		5 min	33.3	66.5
	1 min	37.5	75.0	113		1 min	37.5	75.0

(1) Initial condition $P_{out} \leq 80\% P_n$.

Electrical characteristics - Inverter short-circuit

		Number of power modules						Number of power modules	
		1	2	3	4			1	2
Inverter short-circuit (A) $I_{k1} = I_{k2} = I_{k3}$	40 ms	100	200	300	400	Inverter short-circuit (A) $I_{k1} = I_{k2} = I_{k3}$	40 ms	100	200
	40 to 80 ms	80	160	240	320		40 to 80 ms	80	160


Electrical characteristics - Bypass overload and short-circuit

		Number of power modules						Number of power modules	
		1	2	3	4			1	2
Bypass overload (A)	Nominal	109				Bypass overload (A)	Nominal	73	
	Continuous	120					Continuous	80	
	30 min	136					30 min	91	
	10 min	163					10 min	109	
	1 sec	> 190					1 sec	> 127	
Bypass I^2t (A ² s)		130000				Bypass I^2t (A ² s)		130000	
Bypass Max Peak Current (A)		5000				Bypass Max Peak Current (A)		5000	

Electrical characteristics - Battery charger max current


		Number of power modules						Number of power modules	
		1	2	3	4			1	2
Standard max. current (A) M4-RI-25		8	16	24	32	Standard max. current (A) M4-RI-25		8	16
Enhanced battery charger max. current (A) M4-RI-25+CH		16	32	48	64	Enhanced battery charger max. current (A) M4-RI-25+CH		16	32

2.3 RECOMMENDED PROTECTION DEVICES

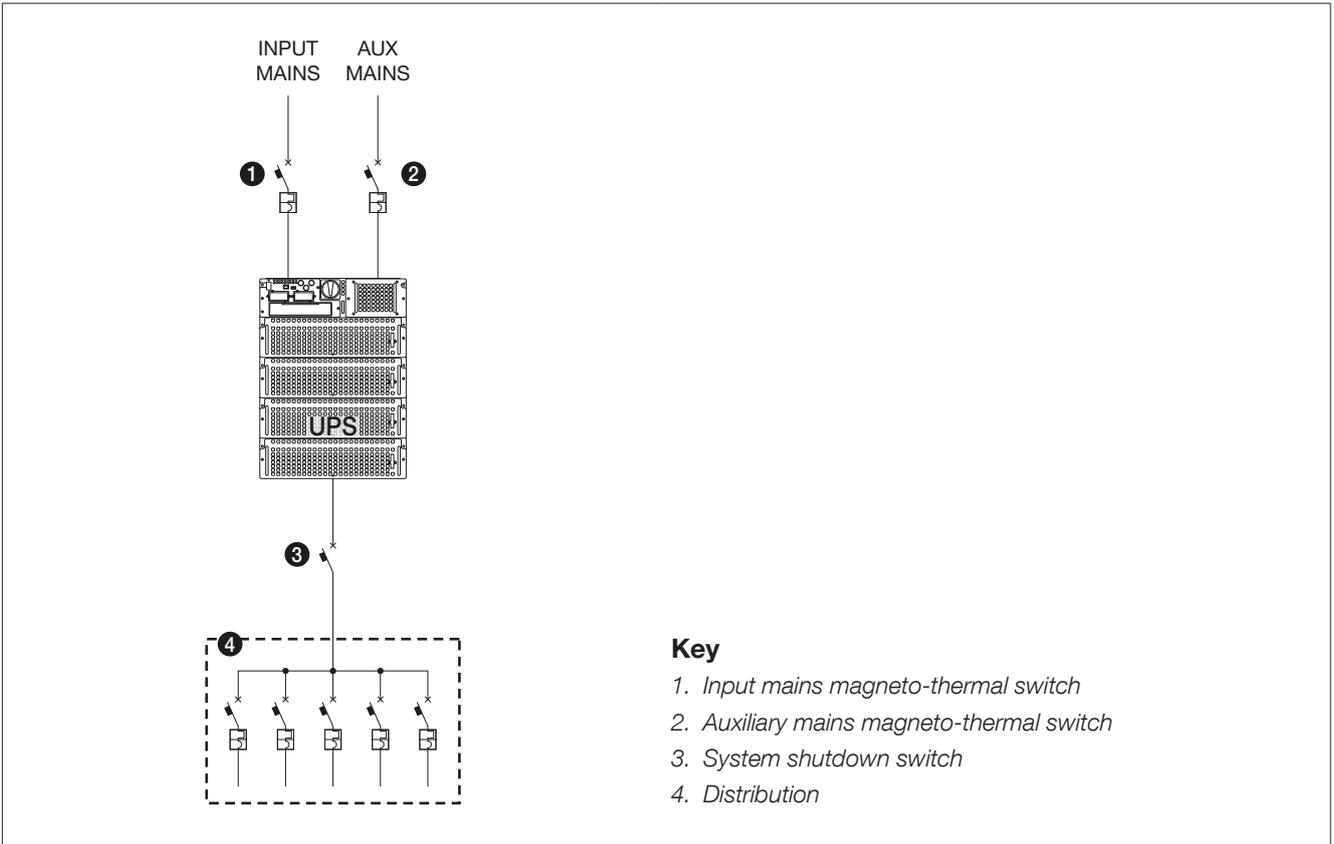

The installation and system should comply with national plant regulations.

The electrical distribution panel should have a sectioning and protection system installed for input and auxiliary mains.

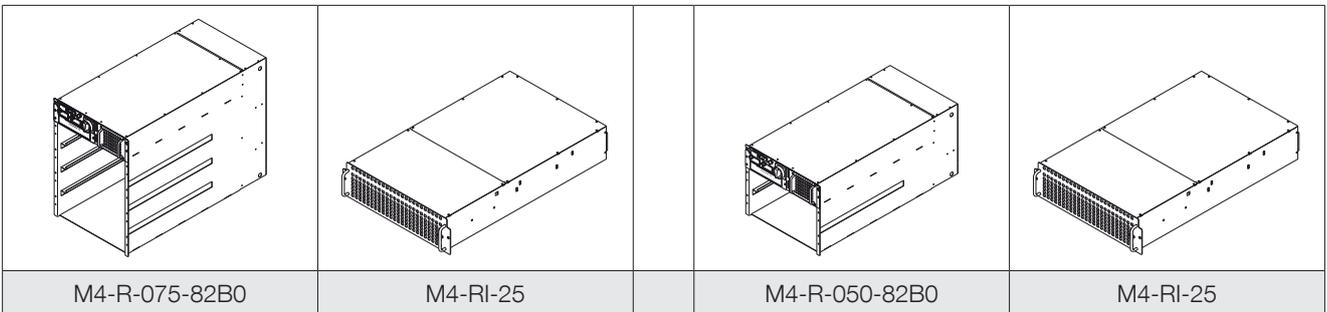

Recommended protection devices - Rectifier				
		Number of power modules		
Without redundancy		1	2	3-4
N+1 redundancy		2	3	4
C curve circuit breaker (A)	Min	50	100	160
	Max	160		
Gg fuse (A)	Min	50	100	160
	Max	160		

		Number of power modules	
Without redundancy		1	2
1+1 redundancy		2	-
C curve circuit breaker (A)	Min	50	100
	Max	160	
Gg fuse (A)	Min	50	100
	Max	100	

A circuit breaker switch is recommended with a magnetic tripping threshold of $\geq 10 I_n$ (curve C). A D curve selective breaker should be fitted if an optional external transformer is used.

The minimum value depends on the size of the power cables in the installation, while the maximum value is limited by the UPS cabinet.

The system can accept the max. value of protection, whatever the number of modules installed, in order to allow future scalability, while the min. value depends on the size of the power cables in the installation. A value of protection less than the recommended Max shall be used when the mains network structure cannot support the full power load, and shall be chosen between max. and min. values (as per the table below) according to the mains network design.

Rectifier protection should be taken into account in the event of separate inputs; when the auxiliary mains and rectifier inputs are combined (common input), the general input protection rating should be higher than both (auxiliary mains or rectifier).

Recommended protection devices - Auxiliary mains						
		Number of power modules				
		1	2	3	4	
C curve circuit breaker (A)	Min	50	100	160	200	
	Max	200				
Gg fuse (A)	Min	50	100	160	200	
	Max	200				

If an optional external transformer is used, a D curve selective breaker should be used.

Auxiliary mains protection should be taken into account in the event of separate inputs; when the auxiliary mains and rectifier inputs are combined (common input), the general input protection rating should be higher than both (auxiliary mains or rectifier).

Recommended protection devices - Input residual current circuit breaker					
		Number of power modules			
		1	2	3	4
Input residual current circuit breaker (A)		0.5			

An RCD is not necessary when the UPS is installed in TN-S system. RCDs are not allowed on TN-C systems. If an RCD is required, a B type should be used.

Caution!

Use four-pole selective (S) residual current detectors (RCDs). Load leakage currents are to be added to those generated by the UPS and during transitory phases (power failures and power returns) short current peaks may occur. If loads with high leakage current are present, adjust the residual current protection. It is advisable in all cases to carry out a preliminary check on the earth current leakage with the UPS installed and operating with the definitive load, so as to prevent the sudden activation of the RCD switch.

Output selectivity on battery mode (Aux mains not present)					
		Number of power modules			
		1	2	3	4
B curve circuit breaker (A)		≤ 20	≤ 40	≤ 50	≤ 80
C curve circuit breaker (A)		≤ 10	≤ 20	≤ 25	≤ 40

Selectivity of distribution downstream of UPS with downstream short-circuit (AUX MAINS not present).


2.4 COMMUNICATION OPTIONS

2.4.1 PROGRAMMABLE IN/OUT DRY CONTACT CARD WITH SERIAL LINK


The board is plug&play: the UPS is able to recognize its presence and configuration.

Up to 4 standard operating modes can be selected simply using two jumpers; the selected operating mode manages the ADC outputs and the inputs accordingly.

It is also possible to create a custom operation mode (consult us).

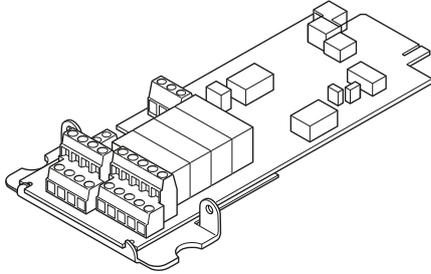
Programmable in/out dry contact card with serial link	
	
CP-OP-ADC+SL	
<ul style="list-style-type: none"> • 4 relays for external device activation (can be set as normally closed or normally open) 	<ul style="list-style-type: none"> - general alarm, - back-up operation, - bypass operation, - preventive maintenance request.
<ul style="list-style-type: none"> • 3 free inputs to report external contacts to UPS 	<ul style="list-style-type: none"> - emergency stop devices (ESD), - operation with generating set, - battery protection status.
<ul style="list-style-type: none"> • 1 connector for external temperature sensor (optional) • RS485 insulated serial link providing MODBUS RTU protocol • 2 LEDs to display the board status 	

2.4.2 MODBUS TCP CARD FOR CONNECTION WITH BMS SYSTEM

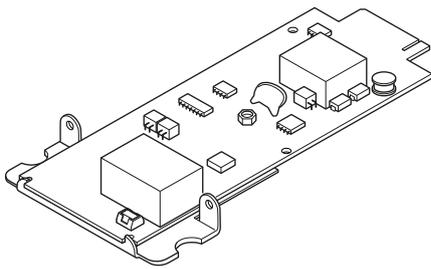MODBUS TCP – IDA interface (MODBUS TCP card)

CP-OP-MODTCP
Detailed information on the MODBUS protocol serial link or Ethernet network for MODULYS RM GP is available in the Modbus TCP User Manual.

2.4.3 NET VISION CARD FOR INTERFACE WITH IT INFRASTRUCTURE

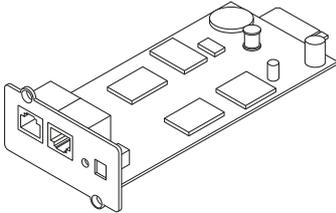Net Vision is a network adapter for the professional monitoring and remote control of MODULYS RM GP. The Net Vision network adaptor allows the UPS to be connected directly to the Ethernet network allowing secure management of the UPS over the network using a web browser, a TELNET interface or NMS application via SNMP. The protocols used for connection are independent of the platform and operating system, therefore Net Vision is extremely flexible and suitable for all systems. In addition to monitoring and control, the Net Vision interface is able to provide a high level of protection for servers powered by the UPS. In critical conditions, up to 250 devices powered by the UPS can be switched off in an orderly sequence whilst ensuring data integrity. The remote shutdown is provided by a client shutdown to be installed on all computers that require this automatic function. Some clients for Net Vision are native to certain operating systems, otherwise a universal shutdown client (JNC) can be used.

NET VISION

NET-VISIONxCARD
<p>NET VISION FUNCTIONS</p> <ul style="list-style-type: none"> • UPS monitoring via HTML pages and synoptic • UPS control • UPS event notification via email • SNMP TRAP notification to NMS system (NET VISION and RFC1628 TRAP from version 6.1 and above) • Server Shutdown (using JNC and VIRTUAL-JNC software agent on servers) • Events and measurements log • Multi-language capabilities

2.4.4 EMD (Environment Monitoring Device)

The EMD monitors temperature, humidity and other conditions in the room’s environment and also offers 2 digital input connections for external dry contacts to monitor water, fire and smoke security alarms. All information is processed by MODULYS RM GP for a complete monitoring of external conditions and alarms. Easy connection to Net Vision card using standard CAT5 cables with straight through wiring.

EMD (Environment Monitoring Device)

Net Vision EMD
<p>EMD FUNCTIONS</p> <ul style="list-style-type: none"> • External temperature monitoring • External humidity monitoring • 2 digital input connections for external dry contacts (for instance to monitor security alarms like fire, smoke, etc.)

2.4.5 EXTERNAL TEMPERATURE SENSOR

The temperature sensor can be used to monitor the battery temperature should the battery cabinet be provided by another supplier by Socomec (all battery cabinets provided by Socomec are fitted with the temperature sensor as standard). The sensor should be connected to the ADC-SL board, using the relative connector. MODULYS RM GP uses the temperature measured by this sensor to correctly set the battery charge profile.

3. REFERENCE STANDARDS AND DIRECTIVES

3.1 OVERVIEW

The construction of the equipment and choice of materials and components comply with all laws, decrees, directives and standards currently in force. In particular, the equipment is fully compliant with all European Directives concerning CE marking.

2006/95/EC

Council Directive 2006/95/EC, dated 16 February 2007, on the reconciliation of legislation within Member States regarding electrical materials for use within specific voltage ranges.

2004/108/EC

On the approximation of the laws of the Member States relating to electromagnetic compatibility.

3.2 STANDARDS - TESTS, VERIFICATIONS AND CERTIFICATIONS

	Standards	
Safety	IEC 62040-1	
EMC	IEC 62040-2 (C2)	
Performance ⁽¹⁾	IEC 62040-3 (VFI-SS-111)	
Power module efficiency ⁽²⁾	IEC 62040-3	up to 96,5 %
Power module MTBF ⁽³⁾	IEC 62380	1.000.000 h
Degree of protection	IEC 60529	IP20
Product certification	CE	

(1) EMC performances are tested and verified by CREI VEN.

(2) Power module efficiency is tested and verified by TÜV SÜD.

(3) Power Module MTBF is calculated and tested by SERMA ELECTRONICS.



ELITE UPS: a mark of efficiency

Socomec, as CEMEP UPS manufacturer member, has signed a Code of Conduct put forward by the Joint Research Centre of the European Commission (JRC), to ensure the protection of critical applications and processes ensuring 24/7 continuous high quality supply. The JRC commits to mitigating energy losses and gas emissions caused by UPS equipment, therefore maximising UPS efficiency.

