



Ref. Certif. No.

CN55586

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT  
(IECEE) CB SCHEME

CB TEST CERTIFICATE

Product

Switch-disconnector

Name and address of the applicant

SOCOMEK S.A.S  
1, Rue De Westhouse 67230 Benfeld Cedex France

Name and address of the manufacturer

SOCOMEK S.A.S  
1, Rue De Westhouse 67230 Benfeld Cedex France

Name and address of the factory

*Note: When more than one factory, please report on page 2*

SOCOMEK S.A.S  
1, Rue De Westhouse 67230 Benfeld Cedex France

☒ Additional information on page 2

Ratings and principal characteristics

See the Appendix

Trademark / Brand (if any)

SOCOMEK

Customer's Testing Facility (CTF) Stage used

Model / Type Ref.

INOSYS LBS 400A, INOSYS LBS 630A, INOSYS LBS 800A

Additional information (if necessary may also be reported on page 2)

IEC 60947-3:2020 in conjunction with IEC 60947-1:2020

A sample of the product was tested and found to be in conformity with

As shown in the Test Report Ref. No. which forms part of this Certificate

00901-CB2021CQC-099628

This CB Test Certificate is issued by the National Certification Body

CHINA QUALITY CERTIFICATION CENTRE

Section 9, No. 188 Nansihuan Xilu, Beijing 100070 P. R. China  
Tel: +86-10-83886666 Fax: +86-10-83886282  
website: <http://www.cqc.com.cn>



Date: Dec.21,2021

Signature:

谢肇煦

Xie ZhaoXu

CB 0066103

**General product information:**

INOSYS LBS 400A, INOSYS LBS 630A, INOSYS LBS 800A

Uimp: 12kV

Ui: 1500V

Ith: 400A, 630A, 800A

Ue: See table 1;

Ie: See table 1

Icw: 10kA/50ms

Icm: 10kA

Utilization category: DC-21B, DC-PV2 (suitable for 400-630A 2P appearance, 4P appearance 1500V)

Table 1

| Ith (A)                                    | 400A | 630A | 800A |
|--------------------------------------------|------|------|------|
| Ie (A) DC-21B<br>1000 VDC (2P/4P)          | 400A | 630A | 800A |
| Ie (A) DC-21B<br>1500 VDC (3P)             | 400A | 630A | 800A |
| Ie (A) DC-21B, DC-PV2<br>1500 VDC (2P, 4P) | 400A | 630A | -    |

Page 1 of 4

Additional information (if necessary)

Date: Dec.21,2021



Signature:

谢肇煦



Xie ZhaoXu

## Connection diagram for DC:

2P(400A/630A/800A)



2P(400A/630A)

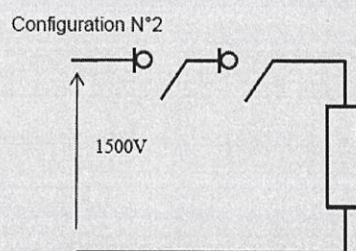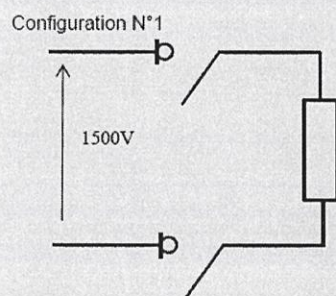

Page 2 of 4


Additional information (if necessary)

Date: Dec.21,2021


Signature: 谢肇煦  
Xie ZhaoXu

3P


Configuration N°1

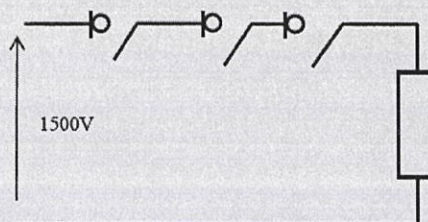

Configuration N°2

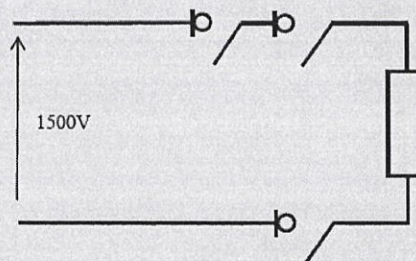

4P Configuration N°1 : 2 回路 (2 circuits)

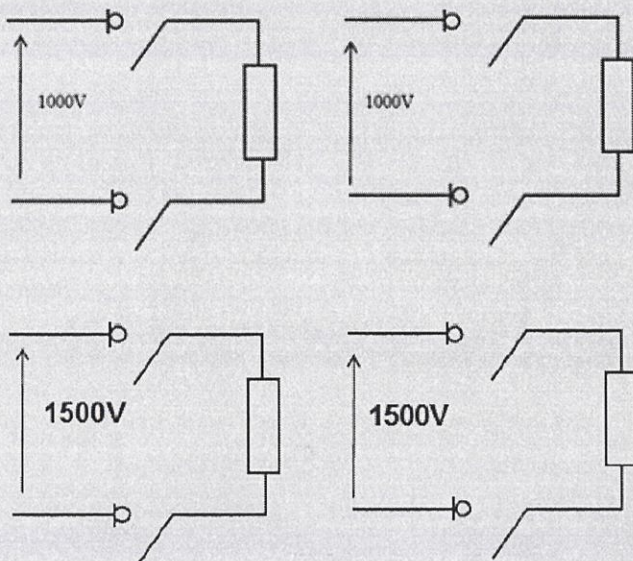

Page 3 of 4

Additional information (if necessary)

Date: Dec.21,2021

Signature:   
Xie ZhaoXu

**Type Explanation:**

INOSYS LBS 800A

(1) (2) (3)

(1) Type

(2) Name of Product: Switch Disconnecter

(3) Rating: 400、630A、800A

Page 4 of 4

Additional information (if necessary)

Date: Dec.21,2021

Signature:

谢肇煦

Xie ZhaoXu

| Name of the factory                   | Address of the factory                                                                            |
|---------------------------------------|---------------------------------------------------------------------------------------------------|
| 1.SOCOMEK ELECTRIC (SHANGHAI) CO.,LTD | A30.NO.5399 Waiqingsong Road,Qingpu Industrial Park,Shanghai City                                 |
| 2.SOCIETE TIMELEC SARL                | ZONE INDUSTRIELLE CHEBEDA ROUTE DE FOUCHANA NAASSEN 1135 NAASSEN GOUVERNORATDE BEN AROUS, Tunisia |

Additional information (if necessary)

Date: Dec.21,2021

Signature:   
Xie ZhaoXu